


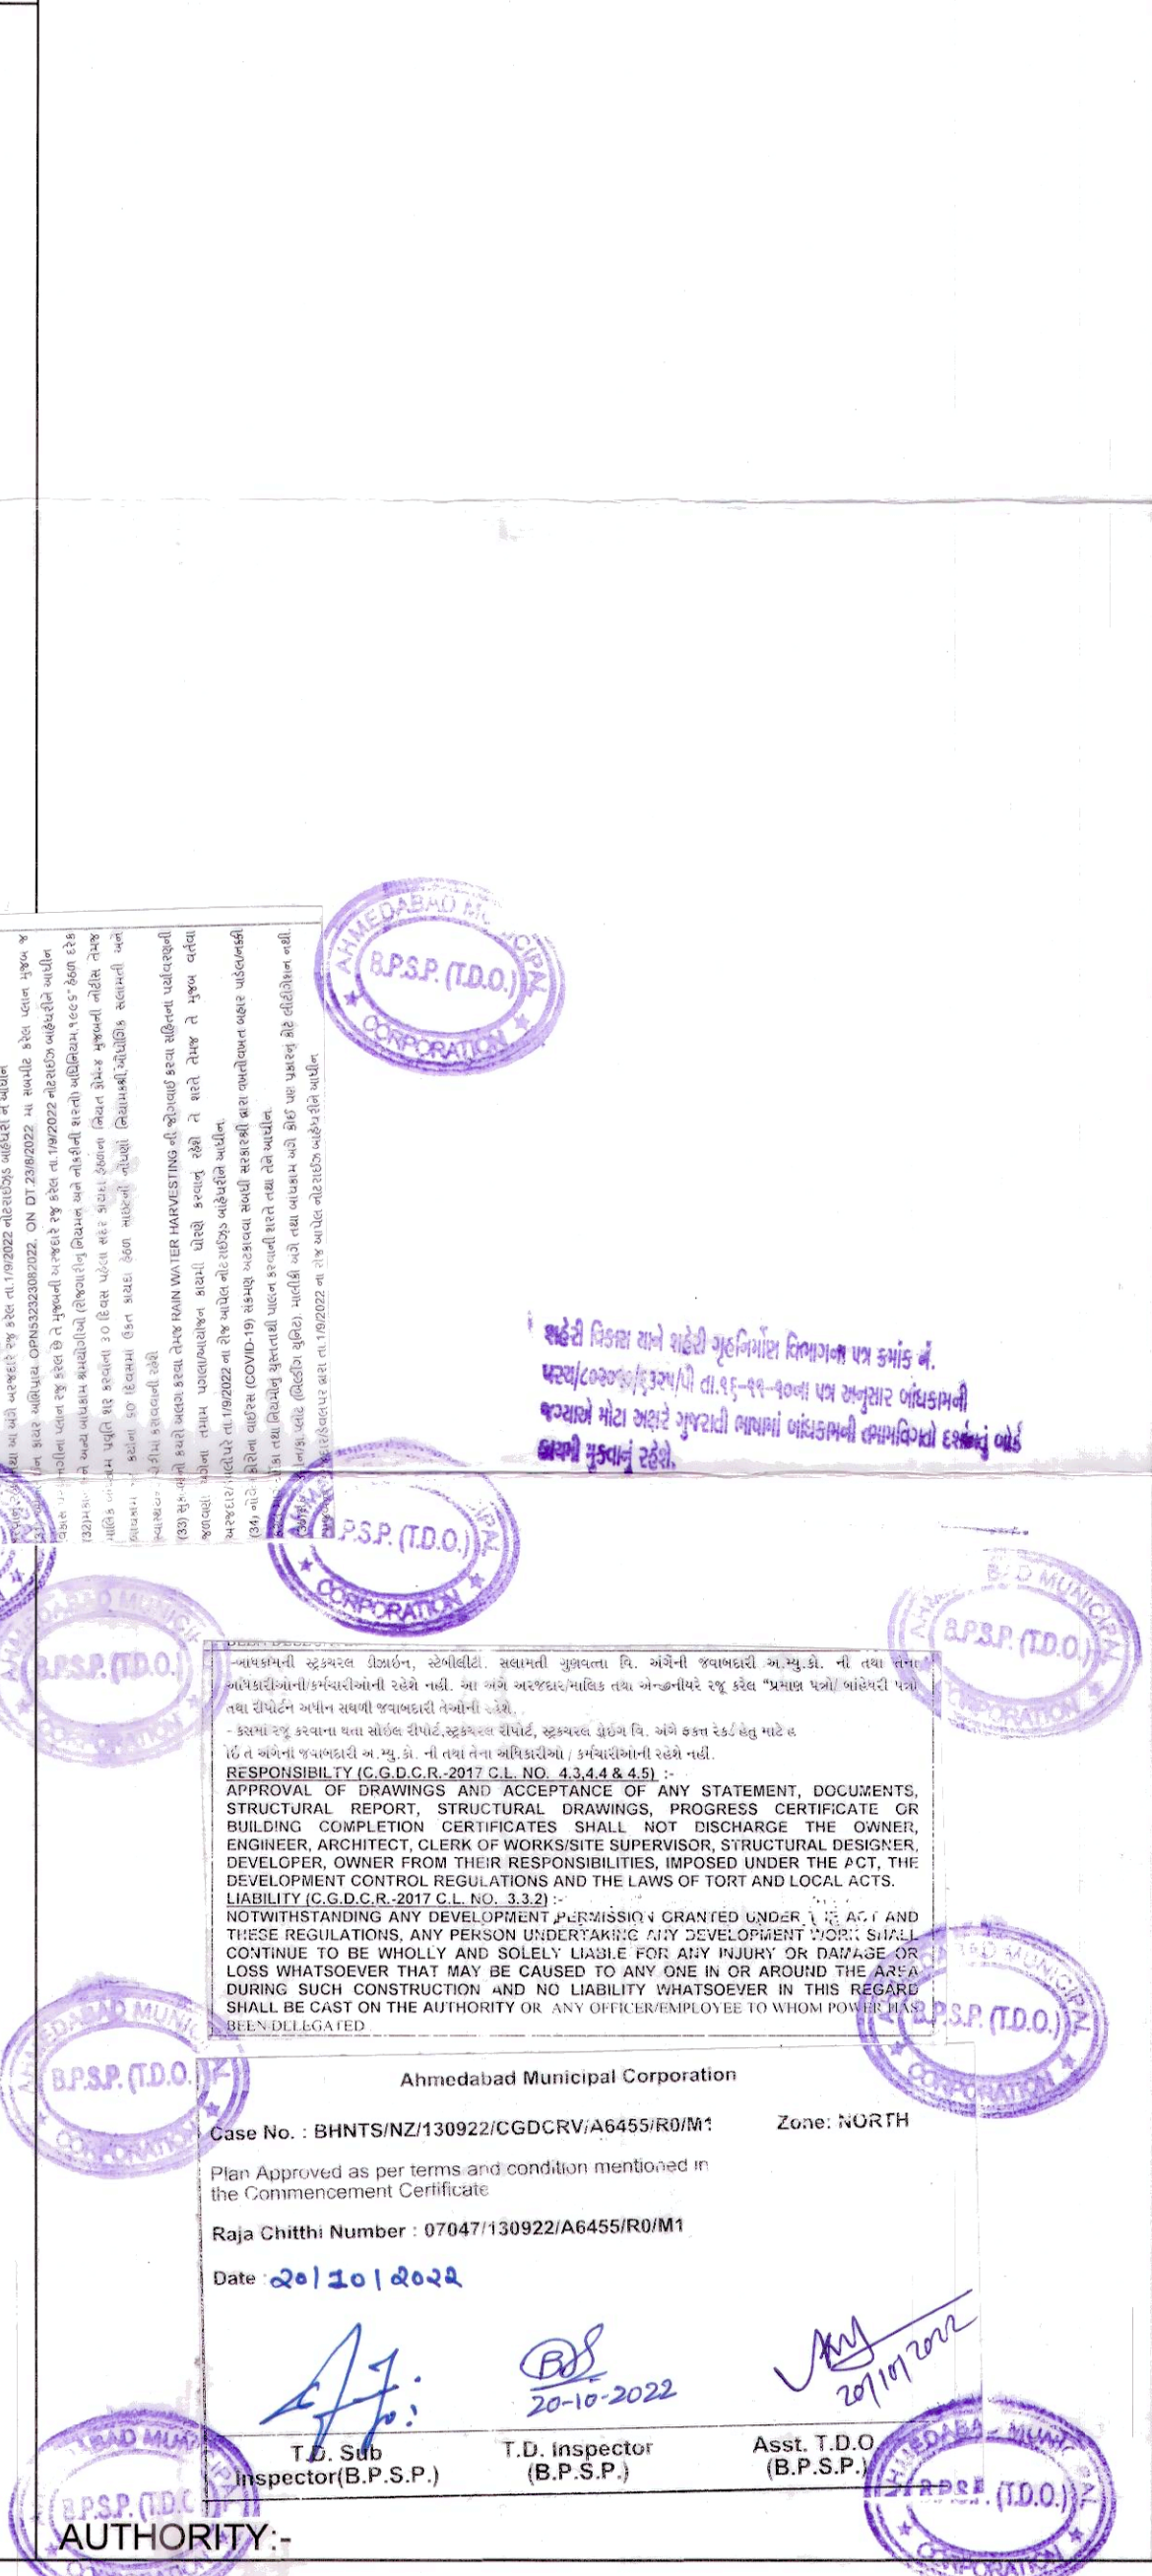
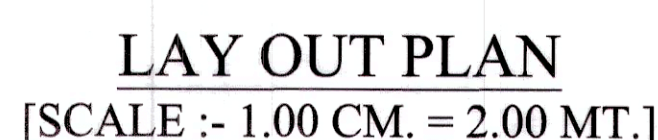
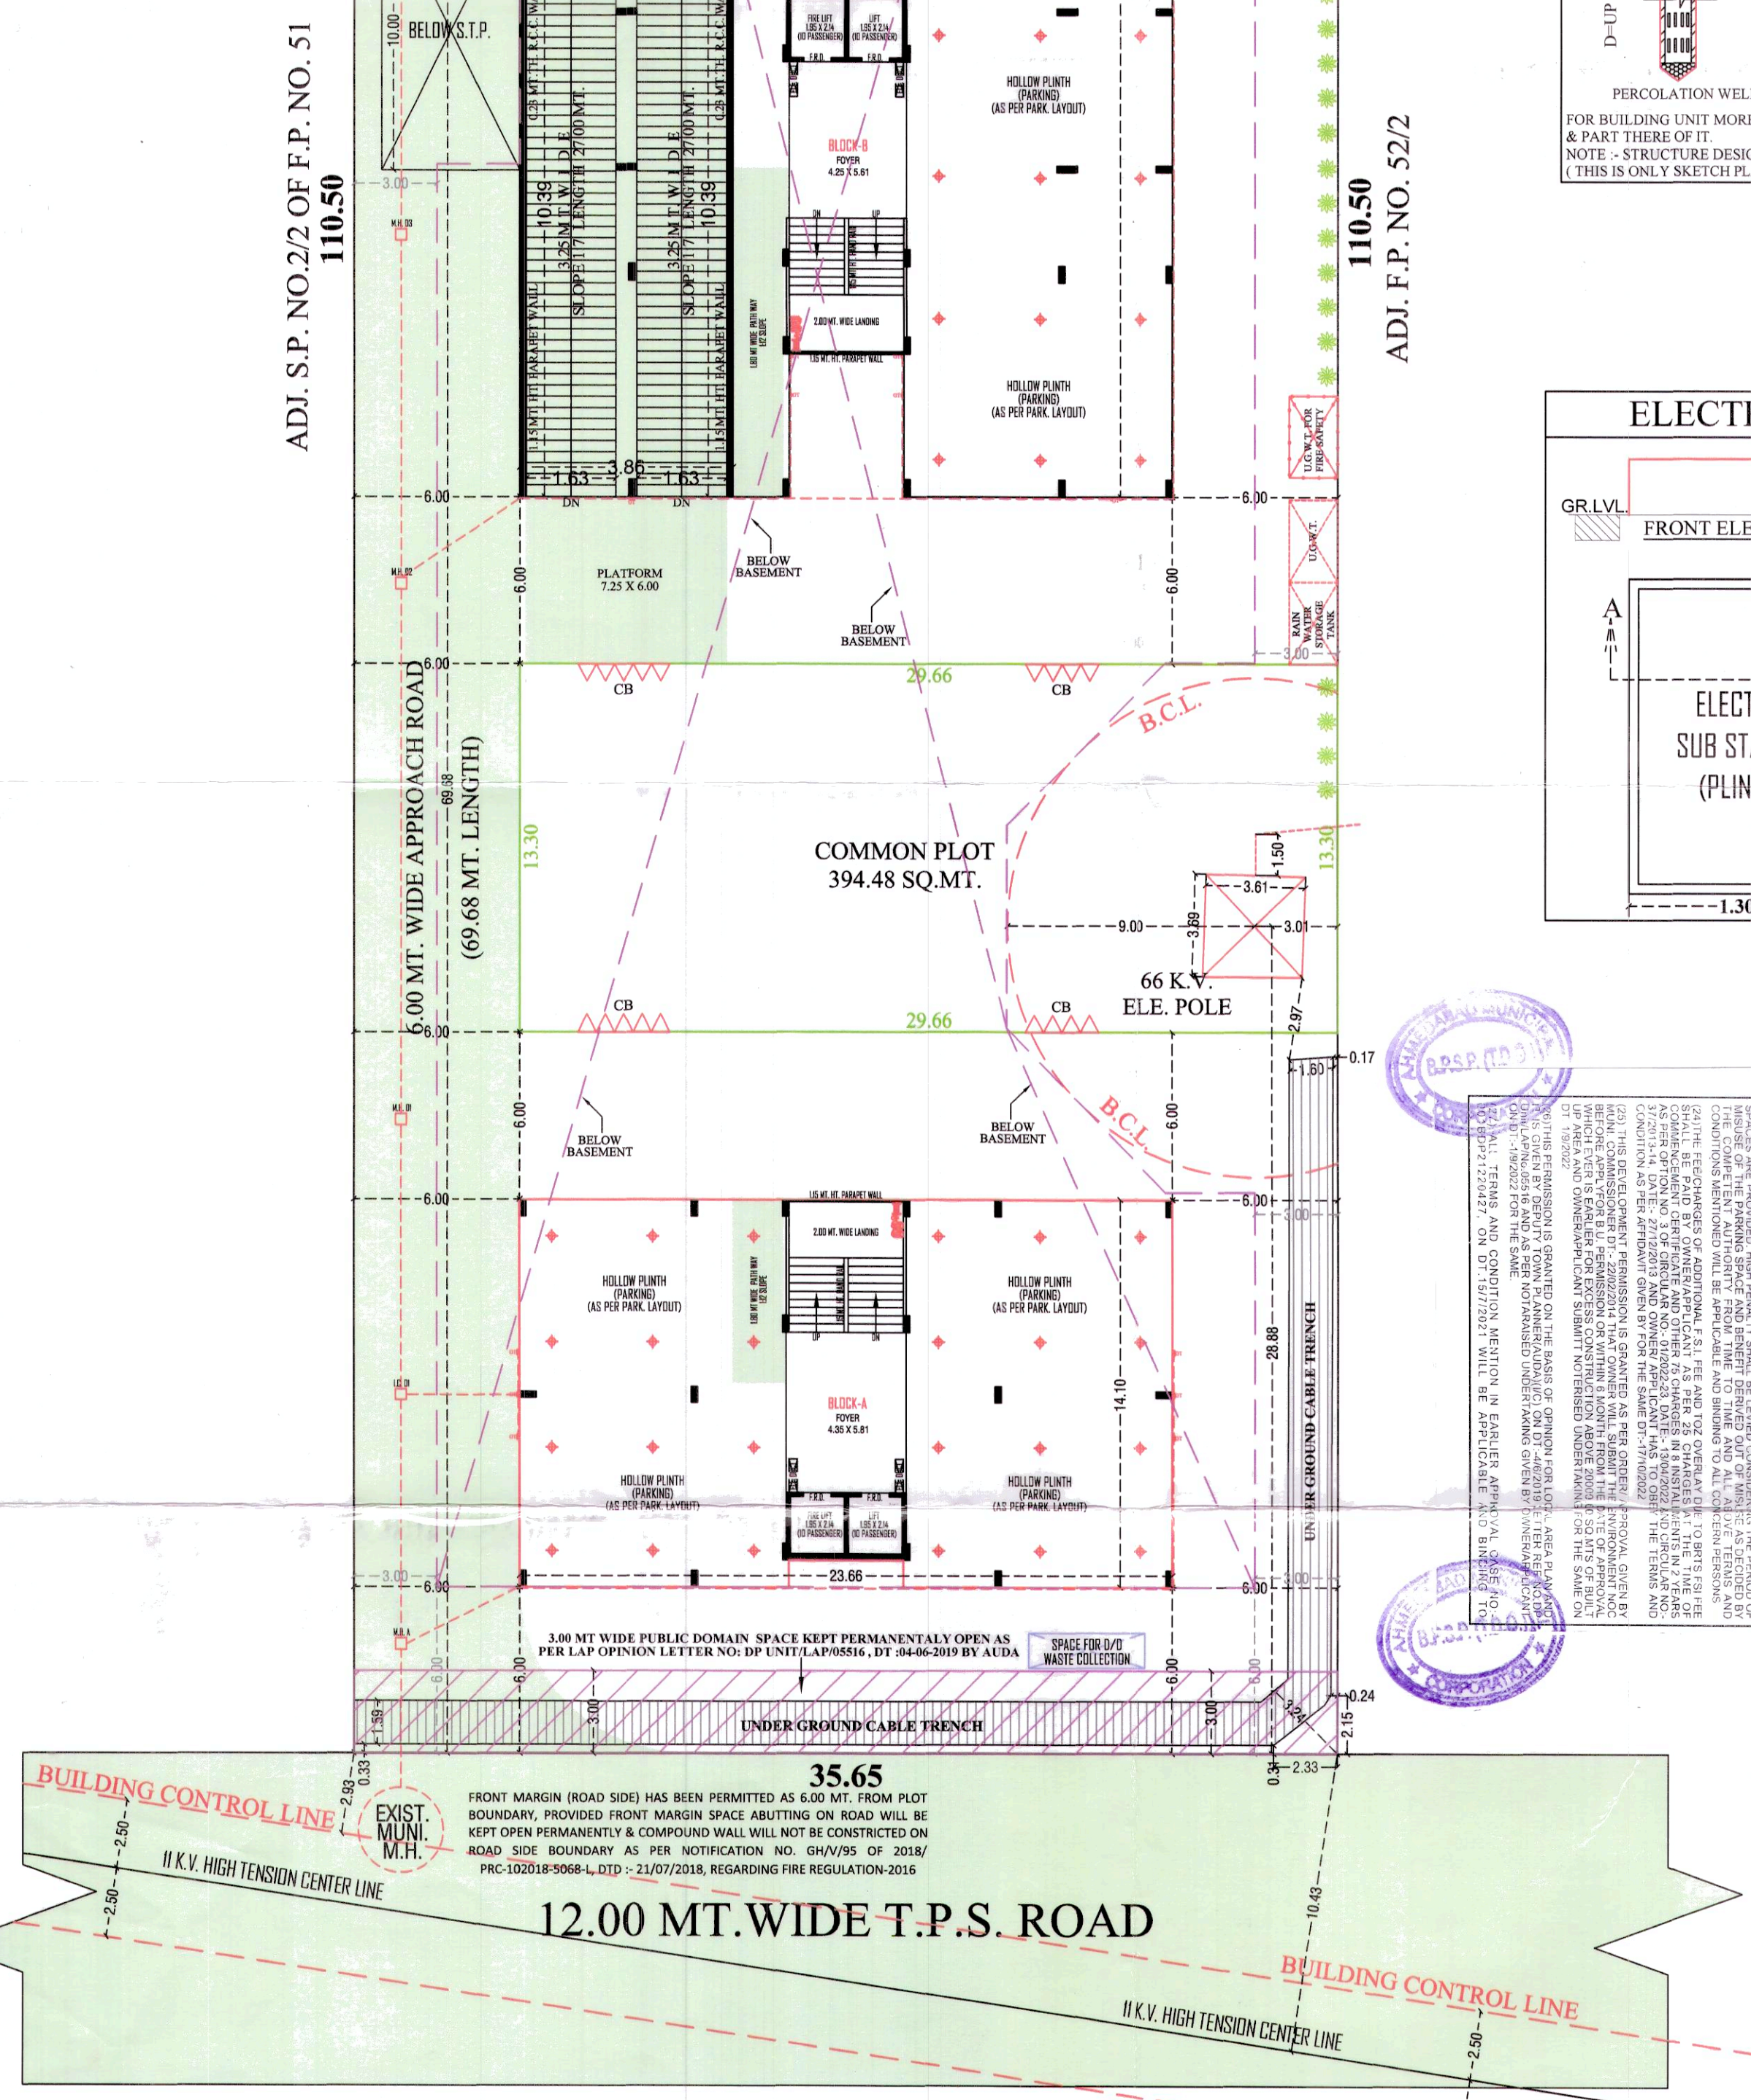
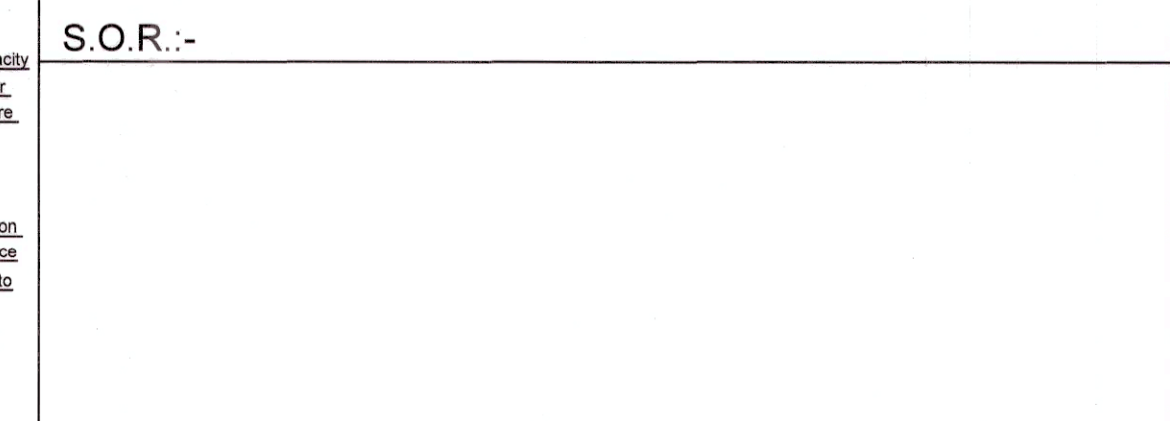
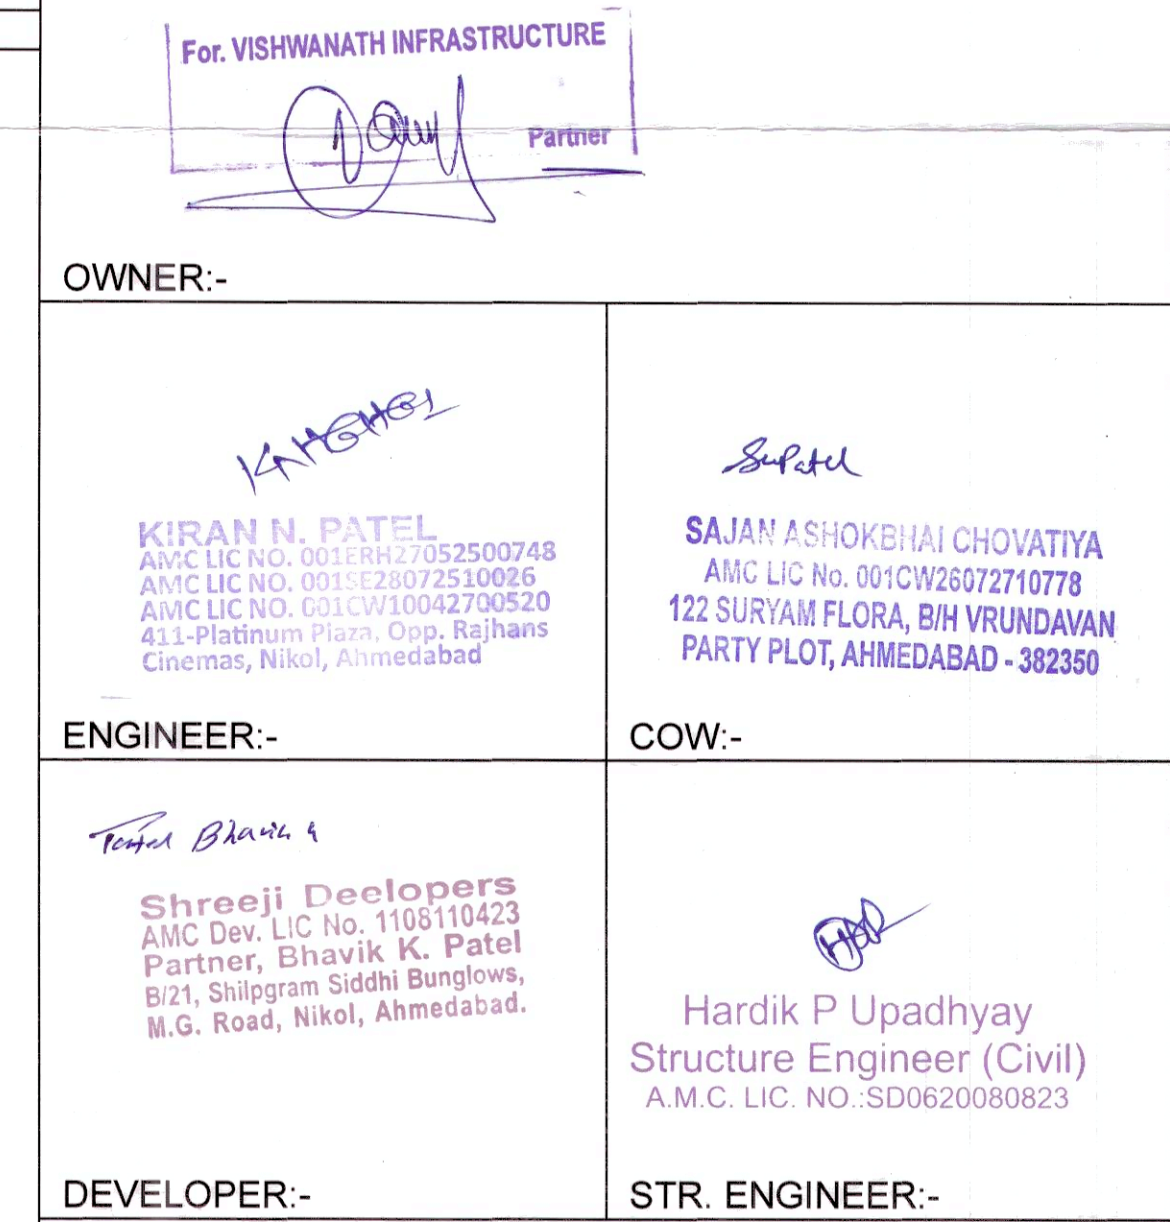
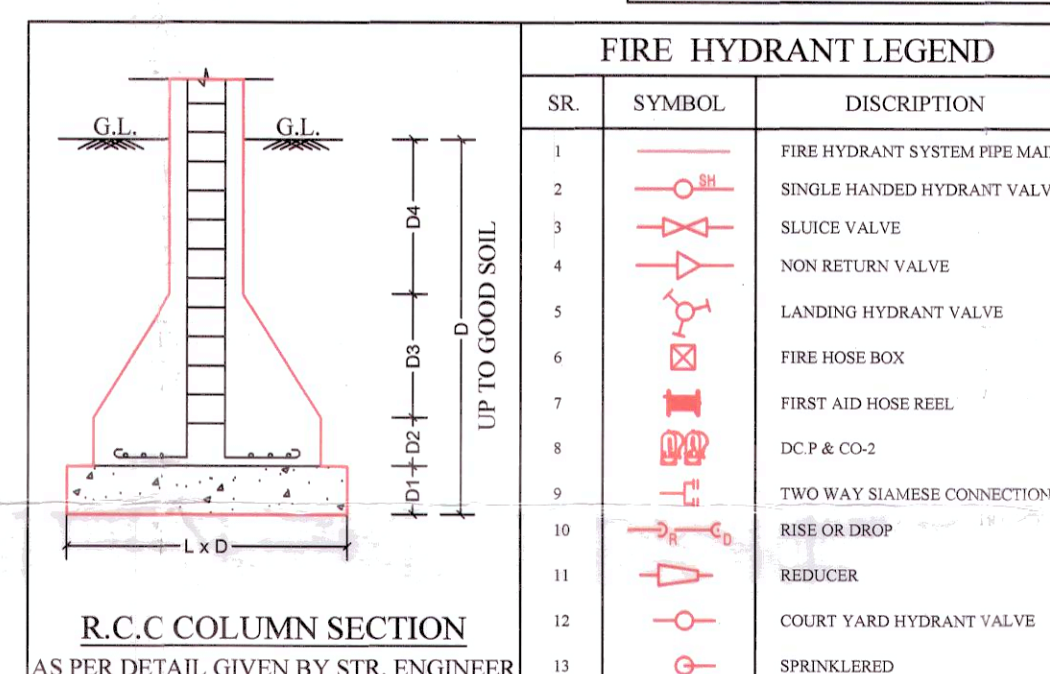
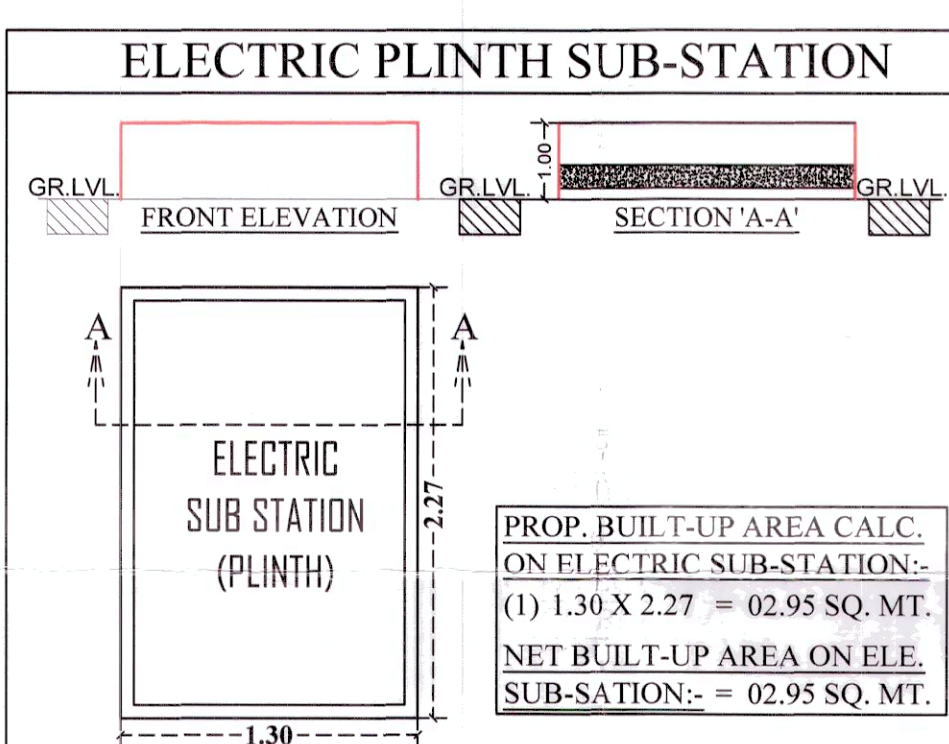
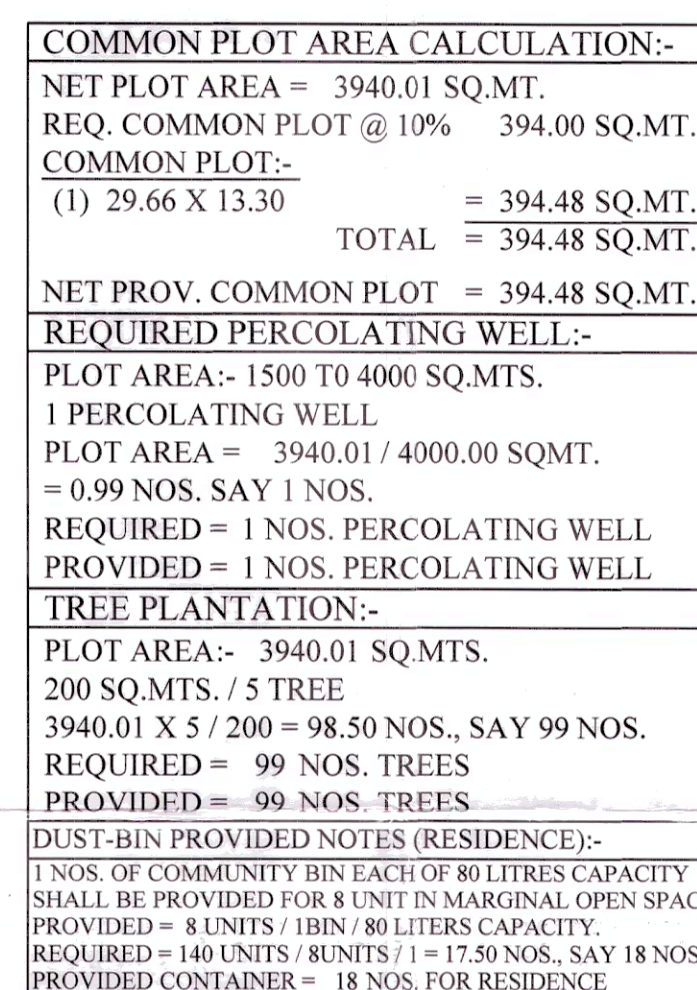
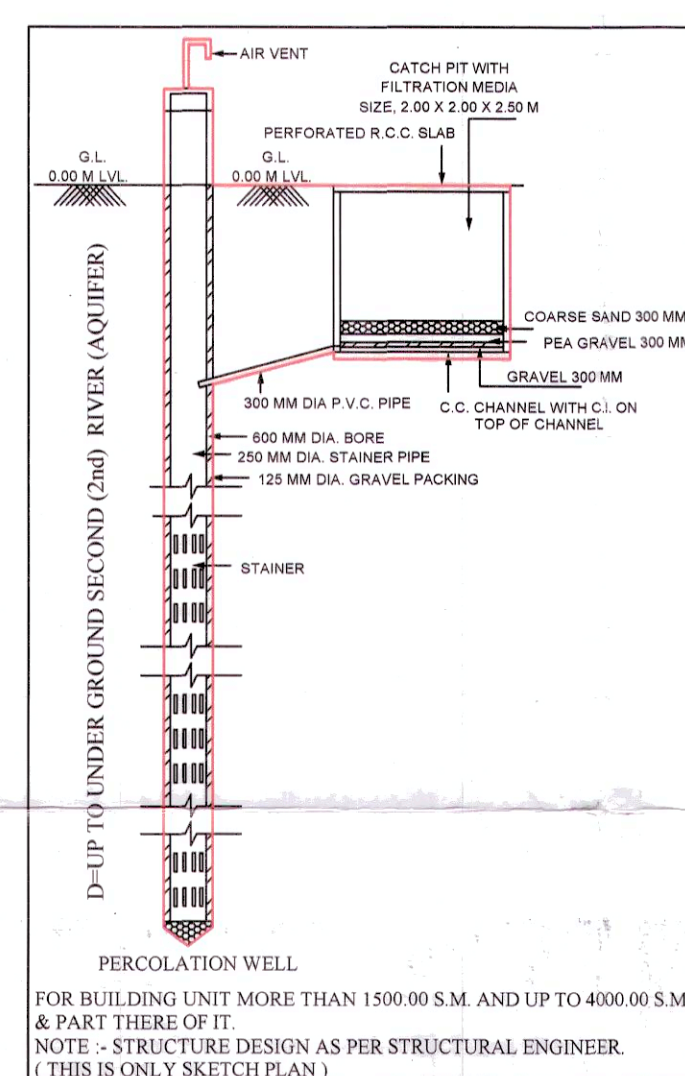
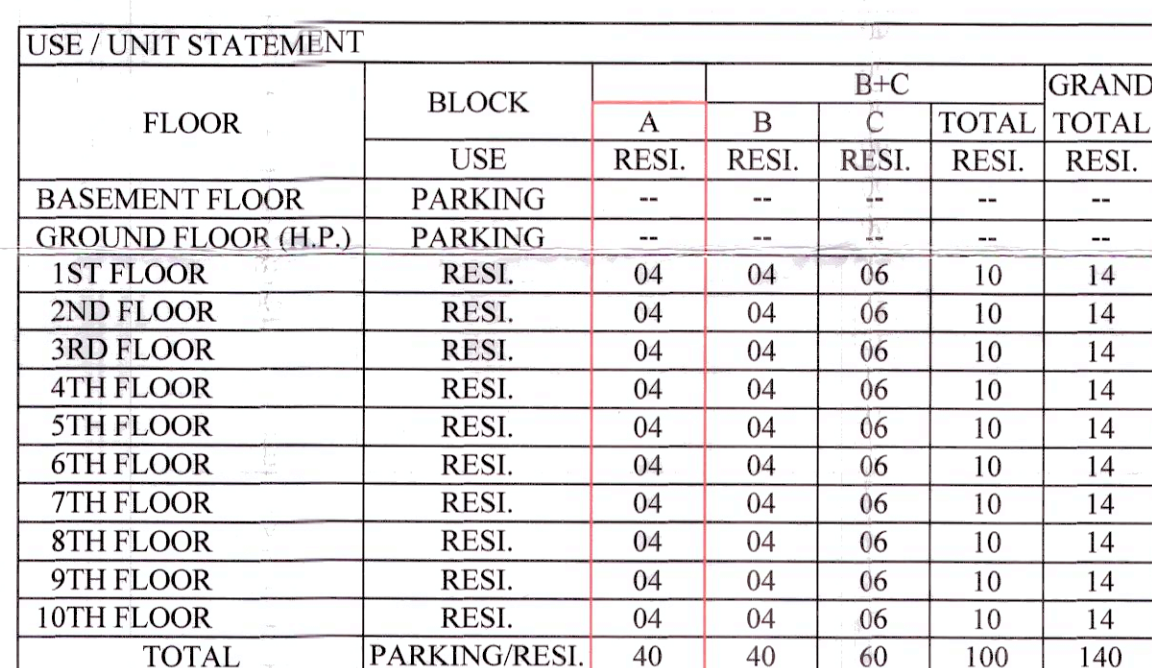
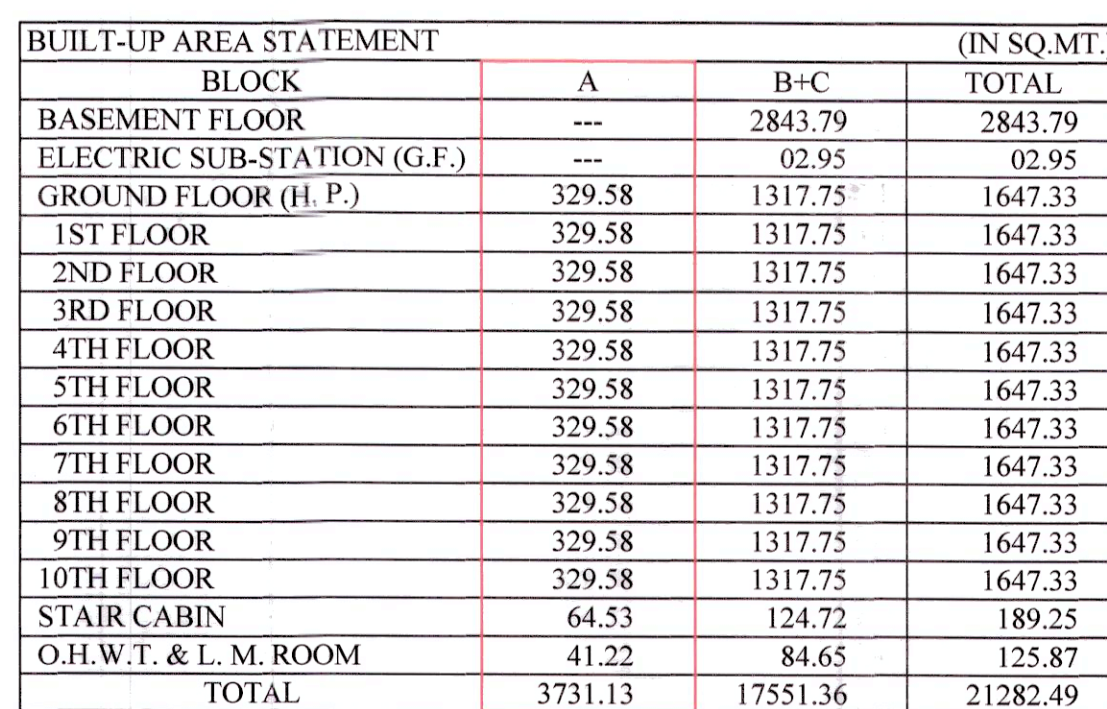
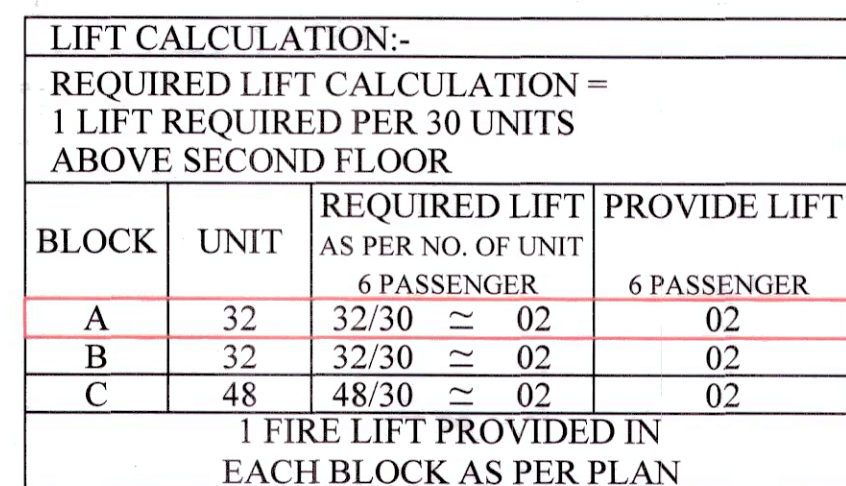


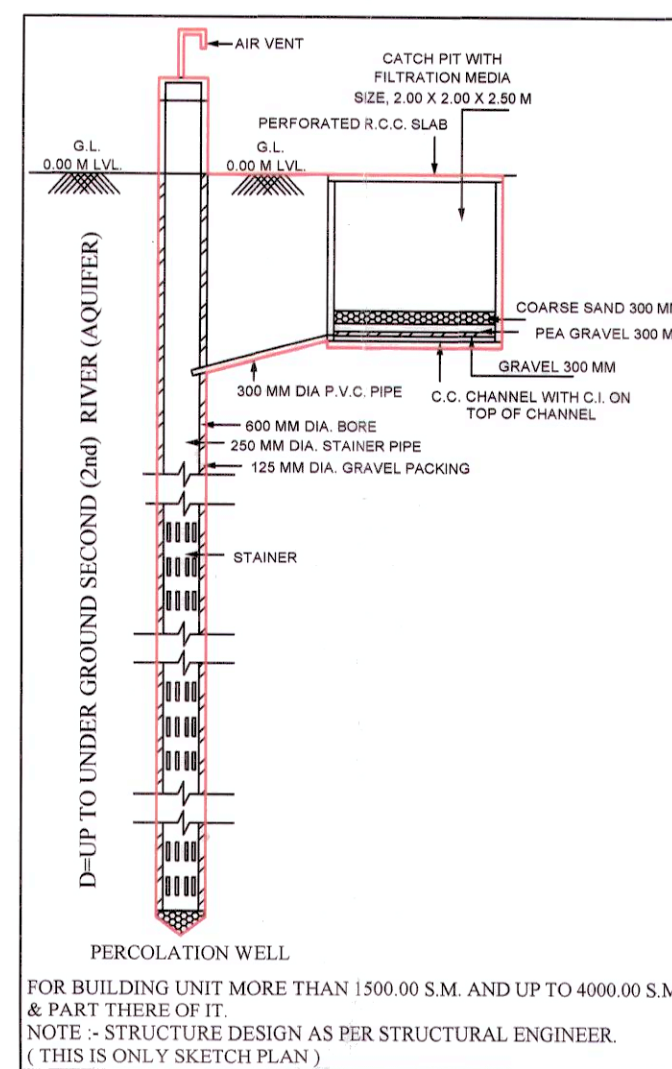

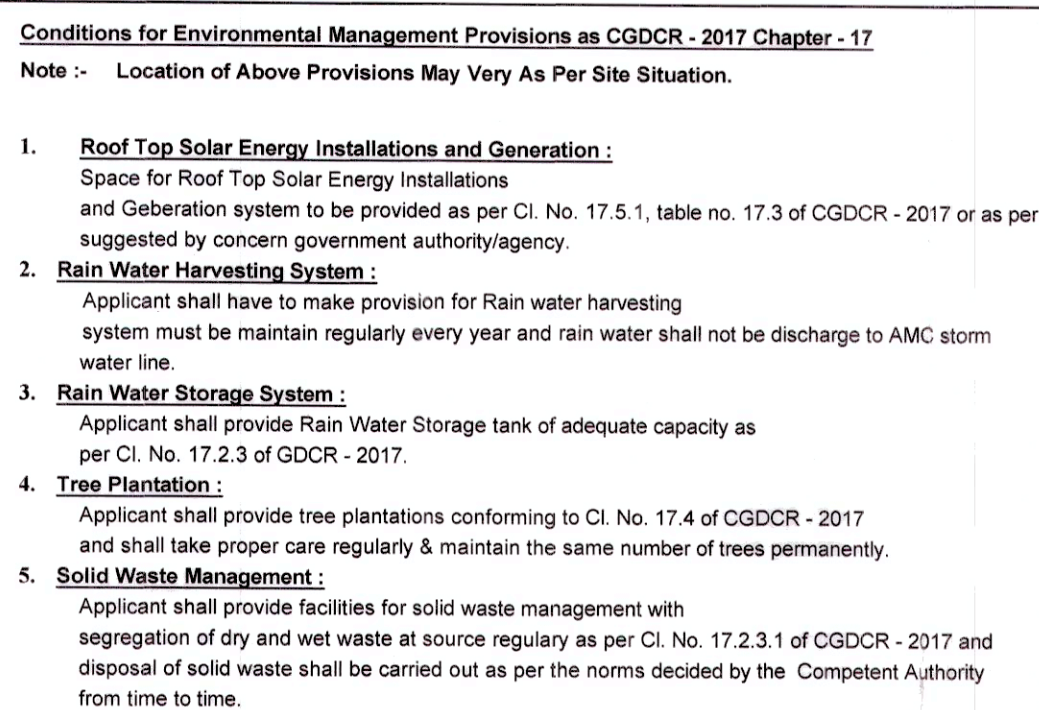

ENGINEER:- <i>Tushar Bhavsara</i> Shreeji Deolopers AMC Deo. No. 1108110423 Partner, Bhavik K. Patel B/21, Shipgram Siddhi Bunglows, M.G. Road, Nikol, Ahmedabad.	COW:- <i>(H/P)</i> Hardik P Upadhyay Structure Engineer (Civil) A.M.C. LIC. NO:-SD0620090823
DEVELOPER:-	STR. ENGINEER:-



REQUIRED PERCOLATING WELLS:-
PLOT AREA:- 1500 TO 4000 SQ.MTS.
1 PERCOLATING WELL
PLOT AREA = 3940.01 / 4000.00 SQMT.
= 0.985 NO. SAY 1 NOS.
REQUIRED = 1 NOS. PERCOLATING WELL
PROVIDED = 1 NOS. PERCOLATING WELL
TREE PLANTATION:-
PLOT AREA:- 3940.01 SQ.MTS.
200 SQ.MTS. / 5 TREES
3940.01 X 5 / 200 = 98.50 NOS. SAY 99 NOS.
REQUIRED = 99 NOS. TREES
PROVIDED = 99 NOS. TREES
DUST-BIN PROVIDED (RESIDENCE):-
1 DUST-BIN PROVIDED FOR EACH OF 100 LITERS CAPACITY.
SHALL BE PROVIDED FOR 8 UNIT IN MARGINAL OPEN SPACE
PROVIDED = 8 UNITS / 100 LITERS CAPACITY
REQUIRED = 8 UNITS / 100 LITERS CAPACITY
PROVIDED CONTAINER = 18 NOS. FOR RESIDENCE

FIRE HYDRANT LEGEND		
SR	SYMBOL	DISCRPTION
1		FIRE HYDRANT SYSTEM PIPE MAIN
2		SINGLE HAND VALVE HYDRANT VALVE
3		SLUICE VALVE
4		NON RETURN VALVE
5		LANDING HYDRANT VALVE
6		FIRE HOSE BOX
7		FIRST AID HOSE REEL
8		D.C.P & C.O-2
9		TWO WAY SAME SIZE CONNECTION
10		RISE/R DROP
11		REDUCER
12		COURT YARD HYDRANT VALVE
13		SPRINKLER

[illegible]

IMPORTANT INSTRUCTIONS:

After inspection of a low-rise building by the fire service authority / the fire officer concerned feels the need for additional fire prevention/protection measures / ventilation system required or equipment (i.e. - Passive system / Suppression system / Fire door - Window / Detection system / Active system / Sprinkler / Drencher etc.) as per Fire load / Fire risk / Public gathering.

Potential / Occupancy / Confined area.

those additional measures / equipment have to be implemented / installed.

Basic Fire Notes Plan
Take online print of approved opinion and submitted plan copy. The copies of plans are provided during final inspection of the fighting system.
After, the building is built and all the required fire safety and Protection equipment have been installed and after due inspection by the fire service officer is NOC can be issued.

સદર પ્રકરણે ચાર્જેસ હયા
બાણ ના હતા મુકવવાના
અગાધિ અપેલા વિભાગની ર

[SCALE :- 1.00 CM. = 2.00 MT.]

[illegible]